### University Works Division Guru Gobind Singh Indraprastha University Sector 16 C, Dwarka

### **Press Notice for Publishing Newspaper**

### NOTICE INVITING TENDER

The Executive Engineer, University Works Division, GGSIPU on behalf of the GGSIPU invites Sealed Item rate tenders from approved and eligible electrical contractors enlisted in the appropriate class in CPWD for the work of:-

Name of work : A/A GGSIP University, Dwarka Campus, New Delhi

Sub Head : Construction of 3 Nos. Sheds for Centre of USMC Department.

(Sub head:- Electrical Works)

NIT No : 09/EE/UWD/Elect/2013-2014

Estimated Cost : Rs. 10,05,467/-, Time of completion : 60 days

EMD : Rs 20,109/-

The tender forms and other details can be obtained from the O/o EE, UWD, GGSIPU on payment of Rs 500/- The last date upto which tender documents can be submitted is 11/07/2013 up to 1500 Hrs. Tenders can be downloaded from website www.ipu.ac.in.

Other detail / information can be seen on website www.ipu.ac.in.

EE/UWD

### **Press Notice for Website**

### **NOTICE INVITING TENDER**

F.No.GGSIPU/UWD/2013/1011-1012

The Executive Engineer, University Works Division, on behalf of the GGSIPU invites Sealed item rate tenders from approved and eligible electrical contractors enlisted in the appropriate class in CPWD for the following work(s).

S. No.	T No.	Name of work & Location	Estimated ost put to	Earnest money	Time of pletion	Last date & Time	ne & date of omission opening of tender
0)	Ħ		Estimated cost put to	Ea	Time of completion	Issue of tender documents	Time & date of submission & opening of tender
1	2	3	4	5	6	7	8
-	09/EE/UWD/Elect/2013- 2014	Name of work:- A/A at GGSIP University, Dwarka Campus, New Delhi SH: Construction of 3 Nos. Sheds for Centre of USMC Department. (Sub head:- Electrical Works)	Rs. 1005467/-	Rs. 20109/-	60days	10/07/2013 4:00 PM	11/07/2013 upto 3:00PM 11/07/2013, 3:30 PM

The tender forms can be obtained from Office of Executive Engineer, UWD on payment of tender processing fee of Rs. 500/- in form of Demand Draft in favour of Registrar GGSIPU. Tender can also be down loaded form website <a href="https://www.ipu.ac.in">www.ipu.ac.in</a>. In case of down loaded tender, tender processing fee shall be paid alongwith the bid.

Eligibility documents i.e. Earnest Money, enlistment in appropriate class, Registration with Sales tax Deptt., PAN CARD, valid electrical license and tender cost in case of download documents should be deposited in envelop marked "Eligibility documents". Tender documents alongwith duly filled Financial bid shall be placed in separate envelope marked "Tender with Financial bid" Earnest money shall be in shape of Fixed Deposit receipt of a Scheduled Bank or Demand Draft of a scheduled Bank issued in favour of Registrar, GGSIPU. A part of earnest money is acceptable in the form of bank guarantee also. In such case, 50% of earnest money or Rs.20 lacs, whichever is less, will have to be deposited in shape prescribed above, and balance in shape of Bank Guarantee.

Both sealed envelopes (Eligibility documents and Tender with financial bid) shall be submitted together in another sealed envelope superscribed with name of work and due date of opening. The envelope marked "Tender with financial bid" of only those bidders shall be opened whose "Eligibility documents", placed in other envelope are found to be in order.

--sd--

**Executive Engineer** University Works Division

Dated: 01/07/2013

Copy to:

- 1) Div Accountant, GGSIPU
- 2) Server In charge, GGSIPU With a request to upload on website

--sd--

**Executive Engineer University Works Division** 



## GURU GOBIND SINGH INDRAPRASTHA UNIVERSITY

## **Tender Document**

Name of Work: A/A at GGSIP University, Dwarka

Campus, New Delhi

Sub Head: Construction of 3 Nos. Sheds for Centre


of USMC Department (Sub head:-

Electrical Works)

Executive Engineer University Works Division Ground Floor, Library Block, GGSIPU, Sector- 16C, Dwarka,

New Delhi – 110078 Contact : 25302291

Document Fee: Rs 500.00 (Non-refundable)

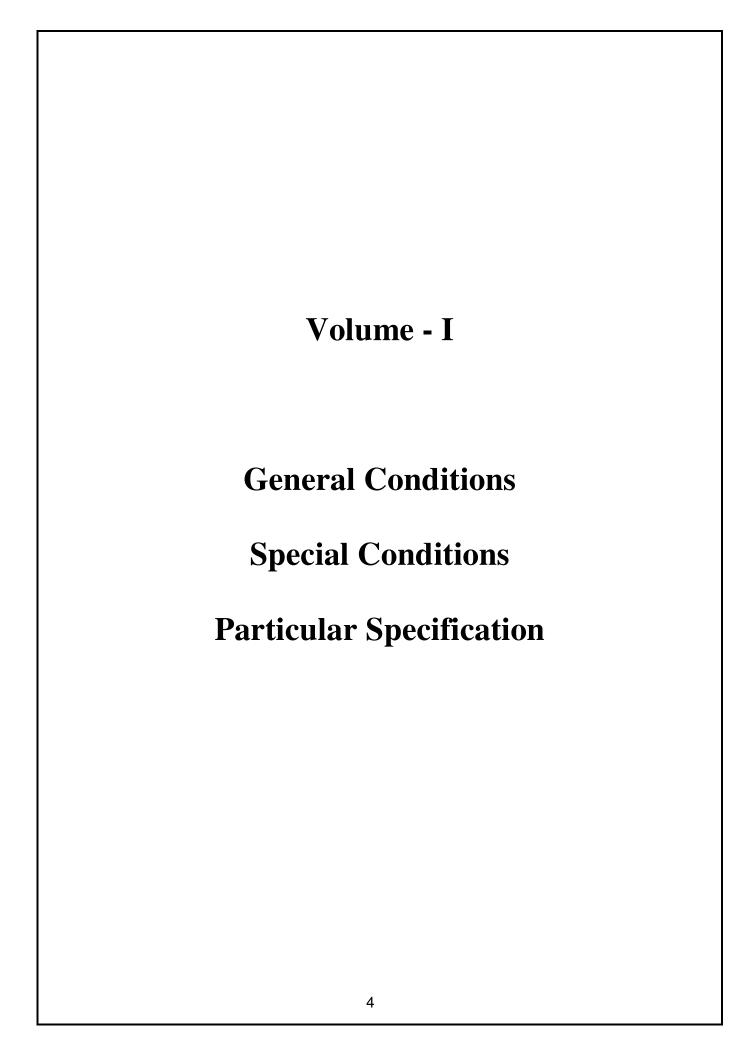

## **INDEX**

Name of Work: A/A at GGSIP University, Dwarka Campus, New Delhi

Sub Head: Construction of 3 Nos. Sheds for Centre of USMC

Department. (Sub Head:- Electrical Works)

S.No.	Description	Page Nos.
1.	Press Notice for News Paper	1
2.	Notice Inviting Tender for Website	2
3.	Notice Inviting Tender	6-9
4.	Integrity Pact	10-16
5.	Letter of submission	17-18
6.	Forms of Submission	19
7.	General Rules and Directions	20-22
8.	Conditions of Contract	23-25
9.	Form of Performance Security and Earnest Money Deposit– Bank Guarantee Bond	26-29
10	Proforma of Schedules A to F	30-32
11	Special Conditions & Technical Specifications	33-36
12	List of approved makes	37-38
13	Schedule of Quantities	39-45

### NOTICE INVITING TENDER

1. The Executive Engineer, University Works Division, on behalf of the GGSIPU invites Sealed item rate tenders from approved and eligible electrical contractors enlisted in the appropriate class in CPWD for the work of:-

Name of Work: A/A at GGSIP University, Dwarka Campus, New Delhi

**Sub Head:** Construction of 3 Nos. Sheds for Centre of USMC

Department. (Sub Head:- Electrical Works)

The enlistment of the contractors should be valid on the last date of sale of tenders.

In case only the last date of sale of tender is extended, the enlistment of contractor should valid on the original date of sale of tenders.

In case both the last date of receipt of application and sale of tenders are extended, the enlistment of contractor should be valid on either of the two dates i.e. original date of sale of tender or on the extended date of sale of tenders.

- 2. The work is estimated to cost **Rs. 1005467/-.** This estimate, however, is given merely as a rough guide.
- 3. Agreement shall be drawn with the successful tenderer on prescribed Form No. C.P.W.D. 8 which is available as a Govt. of India Publication. Tenderer shall quote his rates as per various terms and conditions of the said form which will form part of the agreement.
- 4. Tender documents consisting of plans, specifications, the schedule of quantities of the various classes of work to be done and the set of terms & conditions of contract to be complied with by the contractor whose tender may be accepted and other necessary documents can be seen in the office of the EE/UWD between hours of 11:00 AM & 4:00 PM from 01/7/2013 to 09/7/2013 everyday except on Sundays and Public Holidays. Tender is also available on website www.ipu.ac.in.
- 5. Desirous agencies may obtain tender document on request in writing from University Works Division, Ground Floor, Library Block, GGSIPU, Dwarka, New Delhi 110075 on any working day between 1000 Hrs. (IST) to 1500 Hrs. (IST) up to 10/7/2013 on payment of non-refundable fee of Rs.500/- (Rupees Five Hundred Only) in the form of crossed Demand Draft drawn in favour of Registrar, GGSIPU payable at New Delhi. Tenders can also be downloaded from the website www.ipu.ac.in. In case of downloaded tenders, demand draft of Rs. 500/- shall also be enclosed with the bid toward tender document cost in form of Demand Draft in favour of Registrar, GGSIPU payable at New Delhi.

Applications for issue of forms shall be received by **10/7/2013** (3:00 PM) and tender documents shall be issued by **10/7/2013**. (4:00 PM).

6. Agencies fulfilling the above criteria mentioned at Sl. 1 may submit the tender documents along with Earnest Money Rs.20109/- (Rupees Twenty Thousand One Hundred Nine only) in the shape of fixed deposit receipt of a scheduled bank or demand draft of a scheduled bank issued in favour of Registrar, GGSIPU.

- 7. **50%** of earnest money or **Rs.20,00,000/-,** whichever is less will have to be deposited in the shape prescribed above and balance amount of the earnest money can be accepted in the form of Bank Guarantee issued by scheduled bank having validity of 6 months or more from the last date of receipt of tenders.
- 8. The tender shall be submitted as under.
  - 1.) **Envelop-1** (Superscribed as "Eligibility documents" on the envelop) :- This will consist of following documents.
    - a) EMD
    - **b)** Tender fee, if tender documents are downloaded from website.
    - c) Attested copy of registration for enlistment in appropriate class in CPWD.
    - **d)** Attested copy of PAN card.
    - e) Attested copy of valid electrical license.
    - **f)** Attested copy of valid VAT registration alonwith copy of VAT return, filed up to last quarter of current financial year.
  - 2.) Envelop 2 (Superscribed as "Tender with financial bid" on the envelop): This will consists of Tender documents along with duly filled financial bid.

Both the envelopes shall be submitted together in another sealed envelope with the name of work and due date of opening written on envelope, which will be received by the EE/UWD upto 3:00 PM on 11/7/2013 and will be opened by him or his authorized representative in his office on the same day at 3:30 PM. The envelope marked "Tender with financial bid" of only those tenderers shall be opened, whose Eligibility documents, placed in the Envelope 1, are found to be in order.

- 9. The time allowed for carrying out the work will be **60 days** from the date of start as defined in Schedule 'F' or from the first date of handing over of site, whichever is later, in accordance with phasing, if any, indicated in the tender documents.
- 10. The site of work is available.
- 11. Last date for submission of tender document is 11/7/2013 upto 15.00 Hrs.
- 12. The Contractor whose tender is accepted, will be required to furnish performance guarantee of 5% (Five Percent) of the tendered amount within the period specified in Schedule F. This guarantee shall be in the form of Banker's Cheque of any scheduled bank/Demand Draft of any scheduled bank/Pay order of any scheduled bank (in case guarantee amount is less than **Rs.1,00,000/-**) or Fixed Deposit Receipts of any Schedule Bank or in the form of an irrevocable bank guarantee bond of any scheduled nationalized bank in accordance with the form prescribed.
- 13. The description of the work is as follows:

Name of work: A/A at GGSIP University, Dwarka Campus, New Delhi

Sub Head: Construction of 3 Nos. Sheds for Centre of USMC Department (Sub head: Electrical Works)

14. Copies of other drawings and documents pertaining to the works will be open for inspection by the tenderers at the office of Executive Engineer, UWD. Tenderers are

advised to inspect and examine the site and its surroundings and satisfy themselves the form and nature of the site, the means of access to the site, the accommodation they may require and before submitting their tenders and in general shall themselves obtain all necessary information as to risks, contingencies and other circumstances which may influence or affect their tender. A tenderer shall be deemed to have full knowledge of the site whether he inspects it or not and no extra charges consequent on any misunderstanding or otherwise shall be allowed. The tenderer shall be responsible for arranging and maintaining at his own cost all materials, tools & plants, water, electricity, access, facilities for workers and all other services required for executing the work unless otherwise specifically provided for in the contract document. Submission of a tender by tenderer implies that he has read this letter and all other contract documents and has made himself aware of the scope and specifications of the work to be done and of conditions and rates at which stores, tools and plant, etc. will be issued to him by the GGSIPU and local conditions and other factors having a bearing on the execution of the work.

- 15. The competent authority on behalf of the GGSIPU does not bind itself to accept the lowest or any other tender and reserves to itself the authority to reject any or all the tenders received without assigning any reason. All tenders in which any of the prescribed condition is not fulfilled or any condition including that of conditional rebate is put forth by the tenderer shall be summarily rejected.
- 16. Canvassing whether directly or indirectly, in connection with tenders is strictly prohibited and the tenders submitted by the contractors who resort to canvassing will be liable to rejection.
- 17. The competent authority on behalf of GGSIPU reserves to himself the right of accepting the whole or any part of the tender and the tenderer shall be bound to perform the same at the rate quoted.
- 18. The Contractor shall not permitted to tender for works in the UWD responsible for award and execution of contracts, in which his near relative is posted as Divisional Accountant or as an officer in any capacity between the grades of Superintending Engineer and Junior Engineer (both inclusive). He shall also intimate the names of persons who are working with him in any capacity or are subsequently employed by him and who are near relatives to any officer in the GGSIPU. Any breach of this condition by the contractor would render him liable to be removed from the approved list of contractors of this Department.
- 19. The tender for the works shall remain open for acceptance for a period of (90) Ninety days from the date of opening of tenders/ninety days from the date of opening of financial bid in case tenders are invited on 2/3 envelope system. If any tenderer withdraws his tender before the said period or issue of letter of acceptance, whichever is earlier, or makes any modifications in the terms and conditions of the tender which are not acceptable to the GGSIPU, then the GGSIPU shall, without prejudice to any other right or remedy, be at liberty to forfeit 50% of the said earnest money as aforesaid. Further, the tenderer shall not be allowed to participate in the re tendering process of the work.
- 20. This notice inviting Tender shall form a part of the contract document. The successful tenderer/contractor, on issue of letter of Commencement of work by the Accepting Authority, shall, within 15 days from the stipulated date of start of the work, sign the contract consisting of:

- a) Notice inviting tender, Tender document including Schedule of Quantities, Contract clauses, Special conditions, particular specifications and drawings, if any, forming part of the tender document as issued at the time of invitation of tender and acceptance thereof together with any correspondence leading thereto.
- b) Standard Contract form 8 of 2010 alongwith up to date correction slips.

The terms and conditions of this tender document shall have precedence over the corresponding provisions of GCC 2010.

21. The GGSIPU reserve the right to reject any or all prospective applications without assigning any reason and to restrict the list of contractors to any number deemed suitable by it.

**Executive Engineer University Works Division** 

**INTEGRITY PACT** 

Sub: NIT No. 09/EE/UWD/Elct/2013-14 for the work "A/A at GGSIP University, Dwarka Campus, New Delhi. SH:- Construction of 3 Nos. Sheds for USMC Department. (Sub head:-Electrical Work)".

Dear Sir,

It is here by declared that GGSIPU is committed to follow the principle of transparency, equity and competitiveness in public procurement.

The subject Notice Inviting Tender (NIT) is an invitation to offer made on the condition that the Bidder will sign the integrity Agreement, which is an integral part of tender/bid documents, failing which the tenderer/bidder will stand disqualified from the tendering process and the bid of the bidder would be summarily rejected.

This declaration shall form part and parcel of the Integrity Agreement and signing of the same shall be deemed as acceptance and signing of the Integrity Agreement on behalf of the GGSIPU.

Yours faithfully

Executive Engineer (University Works Division)

#### INTEGRITY PACT

To

Executive Engineer, GGSIPU, Sector 16C Dwarka, New Delhi-78

Sub: Submission of Tender for the work of "A/A at GGSIP University, Dwarka Campus, New Delhi SH:- Construction of 3 Nos. Sheds for centre of USMC Department. (Sub head:- Electrical Work)".

Dear Sir,

I/We acknowledge that GGSIPU is committed to follow the principles thereof as enumerated in the Integrity Agreement enclosed with the tender/bid document.

I/We agree that the Notice Inviting Tender (NIT) is an invitation to offer made on the condition that I/We will sign the enclosed Integrity Agreement, which is an integral part of tender documents, failing which I/We will stand disqualified from the tendering process. I/We acknowledge that THE MAKING OF THE BID SHALL BE REGARDED AS AN UNCONDITIONAL AND ABSOLUTE ACCEPTANCE of this condition of the NIT.

I/We confirm acceptance and compliance with the Integrity Agreement in letter and spirit and further agree that execution of the said Integrity Agreement shall be separate and distinct from the main contract, which will come into existence when tender/bid is finally accepted by GGSIPU. I/We acknowledge and accept the duration of the Integrity Agreement, which shall be in the line with Article 1 of the enclosed Integrity Agreement.

I/We acknowledge that in the event of my/our failure to sign and accept the Integrity Agreement, while submitting the tender/bid, GGSIPU shall have unqualified, absolute and unfettered right to disqualify the tenderer/bidder and reject the tender/bid is accordance with terms and conditions of the tender/bid.

Yours Faithfully

(Duly authorized signatory of the Bidder)

### INTEGRITY PACT

### **INTEGRITY AGREEMENT**

THIS Integrity Agreement is made at20	on thisday of
BETWEEN	N
GGSIPU represented through Executive Engineer 'Principal/Owner', which expression shall unless hereof include its successors and permitted assigns )	s repugnant to the meaning or context
AND	
through  "Bidder/Contractor" and which expression shall u hereof include its successors and permitted assigns)	(Hereinafter referred as the nless repugnant to the meaning or context

### Preamble

WHEREAS the Principal/Owner has floated the Tender (NIT No. 09/EE/UWD/Elct/2013-14) (hereinafter referred to as "Tender/Bid") and intends to award, under laid down organizational procedure, contract for A/A at GGSIP University, Dwarka Campus, New Delhi SH: Construction of 3 Nos. Sheds for centre of USMC Department (Sub Head: Electrical Work) (Name of Work) hereinafter referred to as the "Contract".

And WHEREAS the Principal/Owner values full compliance with all relevant laws of the land, rules, regulations, economic use of resources and of fairness/transparency in its relation with its Bidder(s) and Contractor(s).

AND WHEREAS to meet the purpose aforesaid both the parties have agreed to enter into this Integrity Agreement(hereinafter referred to as "Integrity Pact" or "Pact"), the terms and conditions of which shall also be read as integral part and parcel of the Tender/Bid documents and Contract between the parties.

NOW, THEREFORE, in consideration of mutual covenants in this pact, the parties hereby agree as follows and this pact witnesses as under:

### **Article 1: Commitment of the Principal/Owner**

- 1) The Principle/Owner commits itself to take all measures necessary to prevent corruption and to observe the following principles:
  - a) No employee of the Principal/Owner, personally or through any of his/her family members, will in connection with the Tender, or the execution of the Contract, demand, take a promise for or accept, for self or third person, any material or immaterial benefit which the person is not legally entitled to.
  - b) The Principal/Owner will, during the Tender process, treat all Bidder(s) with equity and reason. The Principal/Owner will, in particular, before and during the Tender process, provide to all Bidder(s) the same information and will not

- provide to any Bidder(s) confidential/additional information through which the Bidder(s) could obtain an advantage in relation to the Tender process or the Contract execution.
- c) The Principal/Owner shall endeavour to exclude from the Tender process any person, whose conduct in the past has been of biased nature.
- 2) If the Principal/Owner obtains information on the conduct of any of its employees which is a criminal offence under the Indian Penal code (IPC)/Prevention of Corruption Act, 1988 (PC Act) or is in violation of the principles herein mentioned or if there be a substantive suspicion in this regard, the Principal/Owner will inform the Chief Vigilance Officer and in addition can also initiate disciplinary actions as per its internal laid down policies and procedures.

### **Article 2: Commitment of the Bidder(s)/Contractor(s)**

- It is required that each Bidder/Contractor (including their respective officers, employees and agents) adhere to the highest ethical standards, and report to the Government/Department all suspected acts of fraud or corruption or Coercion or Collusion of which it has knowledge or becomes aware, during the tendering process and throughout the negotiation or award of a contract.
- 2) The binder(s)/Contractor(s) commits himself to take all measures necessary to prevent corruption. He commits himself to observe the following principles during his participation in the Tender process and during the Contract execution:
  - a) The bidder(s)/Contractor(s) will not, directly or through any other person or firm, offer, promise or give to any of the Principal/Owner's employees involved in the Tender process or execution of the Contract or to any third person any material or other benefit which he/she is not legally entitled to, in order to obtain in exchange any advantage of any kind whatsoever during the Tender process or during the execution of the Contract.
  - b) The Bidder(s)/Contractor(s) will not enter with other Bidder(s) into any undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specifications, certifications, subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to cartelize in the bidding process.
  - c) The Bidder(s)/Contractor(s) will not commit any offence under the relevant IPC/PC Act. Further the Bidder(s)/Contractor(s) will; not use improperly;, ( for the purpose of competition or personal gain), or pass on to others, any information or documents provided by the Principal/Owner as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.
  - d) The Bidder(s)/Contractor(s) of foreign origin shall disclose the names and addresses of agents/representatives in India, if any. Similarly Bidder(s)/Contractor(s) of Indian Nationality shall disclose names and addresses of foreign agents/representatives, if any. Either the Indian agent on behalf of the foreign principal or the foreign principal directly could bid in a tender but not both. Further, in cases where an agent participate in a tender on behalf of one manufacturer, he shall not be allowed to quote on behalf of

- another manufacturer along with the first manufacturer in a subsequent/parallel tender for the same item.
- e) The Bidder(s)/Contractor(s) will, when presenting his bid, disclose any and all payments he has made, is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the Contract.
- 3) The Bidder(s)/Contractor(s) will not instigate third persons to commit offences outlined above or be an accessory to such offences.
- 4) The Bidder(s)/Contractor(s) will not, directly or through any other person or firm indulge in fraudulent practice means a willful misrepresentation or omission of facts or submission of fake/forged documents in order to induce public official to act in reliance thereof, with the purpose of obtaining unjust advantage by or causing damage to justified interest of other and/or to influence the procurement process to the detriment of the Government interests.
- 5) The Bidder(s)/Contractor(s) will not, directly or through any other person or firm use Coercive Practices (means the act of obtaining something, compelling an action or influencing a decision through intimidation, threat or the use of force directly or indirectly, where potential or actual injury may befall upon a person, his/her reputation or property to influence their participation in the tendering process).

### **Article 3: Consequences of Breach**

Without prejudice to any rights that may be available to the Principal/Owner under law or the Contract or its established policies and laid down procedures, the Principal/Owner shall have the following rights in case of breach or this Integrity Pact by the Bidder(s)/Contractor(s) and the Bidder/Contractor accepts and undertakes to respect and uphold the Principal/Owner's absolute right:

- 1) If the Bidder(s)/Contractor(s), either before award or during execution of Contract has committed a transgression through a violation of Article 2 above or in any other form, such as to put his reliability or credibility in question, the Principal/Owner after giving 14 days notice to the contractor shall have powers to disqualify the Bidder(s)/Contractor(s) from the Tender process or terminate/determine the Contract, if already executed or exclude the Bidder/Contractor from future contract award processes. The imposition and duration of the exclusion will be determined by the severity of transgression and determined by the Principal/Owner. Such exclusion may be forever or for a limited period as decided by the Principal/Owner.
- 2) Forfeiture of EMD/Performance Guarantee/Security Deposit: If the Principal/Owner has disqualified the Bidder(s) from the Tender process prior to the award of the Contract or terminated/determined the Contract or has accrued the right to terminate/determine the Contract according to Article 3(1) the principal/owner apart from exercising any legal right that may have accrued to the Principal/Owner, may in its considered opinion forfeit the entire amount of Earnest Money Deposit, Performance Guarantee and Security Deposit of the Bidder/Contractor.
- 3) **Criminal Liability:** If the Principal/Owner obtains knowledge of conduct of a Bidder or Contractor, or of an employee or a representative or an associate of a Bidder or Contractor which constitutes corruption within the meaning of IPC Act, or if the

Principal/Owner has substantive suspicion in this regard, the Principal/Owner will inform the same to law enforcing agencies for further investigation.

### **Article 4: Previous Transgression**

- 1) The bidder declares that no previous transgressions occurred in the last 5 year with any other Company in any country confirming to the anticorruption approach or with Central Government or State Government or any other Central/State Public Sector Enterprises in India that could justify his exclusion from the Tender process.
- 2) If the Bidder makes incorrect statement on this subject, he can be disqualified from the Tender process or action can be taken for banning of business dealings/holiday listing of the Bidder/Contractor as deemed fit by the Principal/Owner.
- 3) If the Bidder/Contractor can prove that he has resorted/recouped the damage caused by him and has installed a suitable corruption prevention system, the Principal/Owner may, at its own discretion, revoke the exclusion prematurely.

### Article 5: Equal Treatment of all Bidders/Contractors/Subcontractors

- 1) The Bidder(s)/Contractor(s) undertake(s) to demand from all subcontractors a commitment in conformity with this Integrity Pact. The Bidder/Contractor shall be responsible for any violation (s) of the principles laid down in this agreement/Pact by any of its Sub-contractor/Sub-vendors.
- 2) The Principal/Owner will enter into Pacts on identical terms as this one with all Bidders and Contractors.
- 3) The Principal/Owner will disqualify Bidders, who do not submit, the duly signed Pact between the Principal/Owner and the bidder, along with the Tender or violate its provisions at any stage of the Tender process, from the Tender process.

### **Article 6: Duration of the Pact**

This Pact begins when both the parties have legally signed it. It expires for the Contractor/Vendor 12 months after the completion of work under the contract or till the continuation of defect liability period, whichever is more and for all other bidders, till the Contract has been awarded.

If any claim is made/lodged during the time, the same shall be binding and continue to be valid despite the lapse of this Pacts as specified above, unless it is discharged/determined by the Competent Authority, GGSIPU.

### **Article 7: Other Provisions**

- 1) This pact is subject to Indian Law, place of performance and jurisdiction is the **Head quarters of the Division** of the Principal/Owner, who has floated the Tender.
- 2) Changes and supplements need to be made in writing. Side agreements have not been made.
- 3) If the Contractor is a partnership or a consortium, this Pact must be signed by all the partners or by one or more partner holding power of attorney signed by all partners

and consortium members. In case of a Company, the Pact must be signed by a representative duly authorized by board resolution.

- 4) Should one or several provisions of this pact turn out to be invalid; the remainder of this Pact remains valid. In this case, the parties will strive to come to an agreement to their original intensions.
- 5) It is agreed term and condition that any dispute or difference arising between the parties with regard to the terms of this Integrity Agreement/Pact or any action taken by the Owner/Principal in accordance with this Integrity agreement /pact interpretation thereof shall not be subject to arbitration.

### **Article 8: Legal and Prior Rights**

All rights and remedies of the parties hereto shall be in addition to all the other legal rights and remedies belonging to such parties under the Contract and/or law and the same shall be deemed to be cumulative and not alternative to such legal rights and remedies aforesaid. For the sake of brevity, both the Parties agree that this Integrity Pact will have precedence over the Tender/Contract documents with regard any of the provisions covered under this Integrity Pact.

IN WITNESS WHERE OF the parties have signed and executed this Integrity Pact at the place and date first above mentioned in the presence of following witnesses:

(For and on behalf of Principal/Owne	r)
(For and on behalf of Bidder/Contrac	tor)
WITNESSES:	
1	
2	
Place:	

Dated:

## Letter of Submission Item Rate Tender

(A) Tender for work of A/A at GGSIP University, Dwarka Campus, New Delhi

ii)

Sub Head: Construction of 3 Nos. Sheds for Centre of USMC Department. (Sub head: - Electrical Works)

- To be submitted by 15.00 HRS hours up to 11/7/2013 to Executive Engineer.
   UWD, Ground Floor, Library Block, GGSIPU, Sector-16C, Dwarka, New Delhi-110075
- 11/07/2013 in the office of Ex Engr, UWD, Ground Floor, Library Block, GGSIPU, Sector-16C, Dwarka, New Delhi-110075

  Issued to -----Signature of officer issuing the documents -----Designation ------

Date of Issue -----

To be opened in presence of tenderers who may be present at 15.30 hours on

### TENDER

I/ We have read and examined the Notice inviting tender, specifications applicable, Drawings & Designs, General Rules and Directions, Conditions of Contract, clauses of contract, special condition, particular Specification, Schedule of Quantities & other documents and Rules referred to in the conditions of contract and all other contents in the tender document for the work.

I/We hereby tender for the execution of the work specified for the GGSIPU within the time specified in Schedule 'F', viz., schedule of quantities and in accordance in all respects with the specifications, designs, drawings and instructions in writing referred to in Rule-1 of General Rules and Directions and in Clause 11 of the Conditions of contract and with such materials as are provided for, by, and in respects in accordance with, such conditions so far as applicable.

We agree to keep the tender open for Ninety (90) days from the due date of opening of tender/ninety days from the date of opening of financial bid in case tenders are invited on 2/3 envelop system and not to make any modifications in its terms and conditions.

The earnest money of **Rs. 20109/-** has been deposited in the shape of fixed deposit receipt of a scheduled bank/ demand draft of a scheduled bank/bank guarantee of scheduled bank issued in favour of Registrar, GGSIPU. If I/we, fail to furnish the prescribed performance guarantee within prescribed period, I/We agree that the said GGSIPU or his successors in office shall without prejudice to any other right or

remedy, be at liberty to forfeit the said earnest money absolutely. Further, if I/we fail to commence work as specified, I/we agree that GGSIPU or his successors in office shall without prejudice to any other right or remedy available in law, be at liberty to forfeit the said earnest money and the performance guarantee absolutely, otherwise the said earnest money shall be retained by him towards security deposit to execute all the works referred to in the tender documents upon the terms and conditions contained or referred to therein and to carry out such deviations as may be ordered, upto maximum of the percentage mentioned in Schedule 'F' and those in excess of that limit at the rates to be determined in accordance with the provision contained in Clause 12.2 and 12.3 of the clauses of contract. Further, I/We agree that in case of forfeiture of earnest money or both Earnest Money & Performance Guarantee as aforesaid, I/We shall be debarred for participation in the retendering process of the work.

I/we hereby declare that I/we shall treat the tender documents drawings and other records connected with the work as secret/ confidential documents and shall not communicate information derived there from to any person other than a person to whom I/we am/are authorized to communicate the same or use the information in any manner prejudicial to the safety of the State.

Date	Signature of Contractor
	Postal Address
Witness:	
Address:	
Occupation:	
ACCEPTA	NCE
The above tender (as modified by you as pris accepted by me for and on behalf of the	GGSIPU for a sum of Rs (Rupees
The letters referred to below shall form par	t of the Agreement:
a)	
b)	
c)	English English
	Executive Engineer
	University Works Department

<u>FORM - 1</u>

## **DECLARATION BY THE BIDDER**

We	_ (Name of the Bidder) hereby represent that we have gone through
and understood the Bidding Do with the requirement stipulated	cument and that our Bid has been prepared accordingly in compliance in the said documents.
stamped on each page in token deemed to form part of our Cor	dding Document marked "Original" as part of our Bid duly signed and of our acceptance. We undertake that the Bidding Document shall be stract Agreement. Further, we shall sign and stamp each page of this as part of the Contract in the event of award of Contract to us.
envelope. We confirm that ra	we indicated prices in Schedule of Quantities and submitted in a sealed ate quoted by us includes price for all works/activities/supply etc. as of the items in Schedule of Quantities.
SIGNATURE OF BIDDER	:
NAME OF BIDDER	:
COMPANY SEAL	<b>:</b>
<b>Note:</b> This declaration shou Bid.	ld be signed by the Bidder's representative who is signing the

### GURU GOBIND SINGH INDRAPRASTHA UNIVERSITY SECTOR-16C, DWARKA, NEW DELHI-110075

- 1. Notice Inviting Tender will state the work to be carried out, as well as the date for submission and opening of tenders and the time allowed for carrying out the work, also the amount of earnest money to be deposited at the time of purchase of tender. The performance Guarantee to be deposited by the successful tenderer and the amount of security deposit to be deducted from bills. Copies of the specifications, designs and drawings and any other documents required in connection with the work signed for the purpose of identification by the officer inviting tender shall also be open for inspection by the contractor at the office of officer inviting tender during office hours.
- 2. In the event of the tender being submitted by a firm, it must be signed separately by each partner thereof or in the event of the absence of any partner, it must be signed on his behalf by a person holding a power of attorney authorizing him to do so, such power of attorney to be produced with the tender, and it must disclose that the firm is duly registered under the Indian Partnership Act, 1952.
- 3. Receipts for payment made on account of work, when executed by a firm, must also be signed by all the partners, except where contractors are described in their tender as a firm, in which case the receipts must be signed in the name of the firm by one of the partners, or by some other person having due authority to give effectual receipts for the firm.
- 4. Any person who submits a tender shall fill up the Schedule of Quantity (Vol.II) form, stating at what rate he is willing to undertake each item of the work. Tenders, which propose any alteration in the work specified in the said form of invitation to tender, or in the time allowed for carrying out the work, or which contain any other conditions of any sort, including conditional rebates, will be summarily rejected. No single tender shall include more than one work, but contractors who wish to tender for two or more works shall submit separate tenders for each. Tender shall have the name and number of the works to which they refer, written on the envelopes.
- 5. The officer inviting tender or his duly authorized representatives, will open tenders in the presence of any intending contractors who may be present at the time, and will enter the amounts of the several tenders in a comparative statement in a suitable form. In the event of a tender being accepted, a receipt for the earnest money forwarded at the time of purchase of tender shall thereupon be given to the contractor who shall thereupon for the purpose of identification sign copies of the specifications and other documents mentioned in Rule-I. In the event of a tender being rejected, the earnest money of unaccepted tenders shall thereupon be returned to the contractor, without any interest.
- 6. The officer inviting tenders shall have the right of rejecting all or any of the tenders and will not be bound to accept the lowest or any other tender.

- 7. The receipt of an accountant or clerk for any money paid by the contractor will not be considered as any acknowledgement or payment to the officer inviting tender and the contractor shall be responsible for seeing that he procures a receipt signed by the officer inviting tender or a duly authorized Cashier.
- 8. The memorandum of work tendered for and the schedule of materials to be supplied by the department and their issue rates, shall be filled and completed in the office of the officer inviting tender before the tender form is issued. If a form is issued to an intending tenderer without having been so filled in and incomplete, he shall request the officer to have this done before be completes and delivers his tender.
- 9. The tenderers shall sign a declaration under the officials Secret Act 1923, for maintaining secrecy of the tender documents drawings or other records connected with the work given to them. Use of correction fluid, anywhere in tender document is not permitted. Such tender is liable for rejection.
- 10. Only rates quoted shall be considered. Any tender containing percentage below/ above the rates quoted is liable to be rejected. Rates quoted by the contractor in item rate tender in figures and words shall be accurately filled in so that there is no discrepancy in the rates written in figures and words. However, if a discrepancy is found, the rates which correspond with the amount worked out by the contractor shall unless otherwise proved be taken as correct. If the contractor does not work out the amount of an item or it does not correspond with the rates written either in figures or in words, then the rates quoted by the contractor in words shall be taken as correct. Where the rates quoted by the contractor in figures and in words tally but the amount is not worked out correctly, the rates quoted by the contractor will unless otherwise proved be taken as correct and not the amount. In event no rate has been quoted for any item(s), leaving space both in figure(s), word(s), and amount blank, it will be presumed that the contractor has included the cost of this/these item(s) in other items and rate for such item(s) will be considered as zero and work will be required to be executed accordingly.
- 11. In the case of any tender where unit rate of any item/ items appear unrealistic, such tender will be considered as unbalanced and in case the tenderer is unable to provide satisfactory explanation, such a tender is liable to be disqualified and rejected.
- 12. All rates shall be quoted on the tender form (i.e. Schedule of Quantities Vol. II). The amount for each item should be worked out and requisite totals given. Special care should be taken to write the rates in figures as well as in words and the amount in figures only, in such a way that interpolation is not possible. The total amount should be written both in figures and in words. In case of figures, the word 'Rs.' should be written before the figure of rupees and word 'P' after the decimal figures, e.g. 'Rs.2.15 P' and in case of words, the word, 'Rupees' should precede and the word 'Paise' should be written at the end. Unless the rate is in whole rupees and followed by the word 'only' it should invariably be upto two decimal places. While quoting the rate in schedule of quantities, the word 'only' should be written closely following the amount and it should not be written in the next line.

- i) The contractor whose tender is accepted shall be required to deposit an amount equal to 5% of the tendered value of the work as performance guarantee within the period as specified in schedule-'F' in the form of an irrevocable bank guarantee bond of any scheduled bank in accordance with the form prescribed, fixed deposit receipt or demand draft in favour of Registrar, GGSIPU.
  - ii) The contractor whose tender is accepted, will also be required to furnish by way of Security Deposit for the fulfillment of his contract, an amount equal to 5% of the tendered value of the work. The Security deposit will be collected by deductions from the running bills of the contractor at the rate of 5% and the earnest money deposited at the time of tenders, will be treated as a part of the Security Deposit. The Security amount will also be accepted in the shape of Fixed Deposit Receipt of a Scheduled Nationalized Bank or State Bank of India will also be accepted for this purpose provided confirmatory advice is enclosed. The security deposit as deducted above can be released against bank guarantee issued by a scheduled bank, on its accumulations to a minimum of Rs. 5 lakh subject to the condition that amount of such bank guarantee, except last one, shall not be less than Rs. 5 lakh.
- 14. On acceptance of the tender, the name of the accredited representative(s) of the contractor who would be responsible for taking instructions from the Engineer-in-Charge shall be communicated in writing to the Engineer-in-Charge.
- 15. Sales Tax/VAT, purchase tax, turnover tax or any other tax on material in respect of this contract shall be payable by the Contractor and GGSIPU will not entertain any claim whatsoever in respect of the same.
- 16. The contractor shall give a list of both gazetted and non-gazetted GGSIPU employees related to him.
- 17. The tender for the work shall not be witnessed by a contractor or contractors who himself/themselves has/have tendered or who may and has/have tendered for the same work. Failure to observe this condition would render, tenders of the contractors tendering, as well as witnessing the tender, liable to summary rejection.
- 18. The tender for composite work includes, in addition to building work, all other works such sanitary and water supply installations drainage installation, electrical work, horticulture work, roads and paths etc. The tenderer apart from being a registered contractor (B&R) of appropriate class, must associate himself with agencies of appropriate class which are eligible to tender for sanitary and water supply drainage, electrical land horticulture works in the composite tender.
- 19. The contractor shall comply with the provisions of the Apprentices Act 1961, and the rules and orders issued there under from time to time. If he fails to do so, his failure will be a breach of the contract and the GGSIPU may in his discretion, without prejudice to any other right or remedy available in law, cancel the contract. The contractor shall also be liable for any pecuniary liability arising on account of any violation by him of the provisions of the said Act.

### CONDITIONS OF CONTRACT

### **Definitions**

- 1. The Contract means the documents forming the tender and acceptance thereof and the formal agreement executed between the competent authority on behalf of the GGSIPU and the Contractor, together with the documents referred to therein including these conditions, the specifications, designs, drawings and instructions issued from time to time by the Engineer-in-Charge and all these documents taken together, shall be deemed to form one contract and shall be complementary to one another.
- 2. In the contract, the following expressions shall, unless the context otherwise requires, have the meanings, hereby respectively assigned to them:
  - i) The expression works or work shall, unless there be something either in the subject or context repugnant to such construction, be construed and taken to mean the works by or by virtue of the contract contracted to be executed whether temporary or permanent, and whether original, altered, substituted or additional.
  - ii) The Site shall mean the land/ or other places on, into or through which work is to be executed under the contract or any adjacent land, path or street through which work, is to be executed under the contract or any adjacent land, path or street which may be allotted or used for the purpose of carrying out the contract.
  - iii) The Agency / Contractor / Tenderer shall mean the individual, firm or company, whether incorporated or not, undertaking the works and shall include the legal personal representative of such individual or the persons composing such firm or company, or the successors of such firm or company and the permitted assigns of such individual, firm or company.
  - iv) The GGSIPU means the Guru Gobind Singh Indraprastha University and his successors.
  - v) The Engineer-in-Charge means the Executive Engineer UWD
  - vi) Accepting Authority shall mean the authority mentioned in Schedule 'F'.
  - vii) Excepted Risk are risks due to riots (other than those on account of contractor's employees), war (whether declared or not) invasion, act of foreign enemies, hostilities, civil war, rebellion revolution, insurrection, military or usurped power, any acts of Government, damages from aircraft, acts of God, such as earthquake, lightening and unprecedented floods, and other causes over which the contractor has no control and accepted as such by the

- Accepting Authority or causes solely due to use or occupation by Government of the part of the works in respect of which a certificate of completion has been issued or a cause solely due to Government's faulty design of works.
- viii) Market Rate shall be the rate as decided by the Engineer-in-Charge on the basis of the cost of materials and labour at the site where the work is to be executed plus the percentage mentioned in Schedule 'F' to cover, all overheads and profits.
- ix) Schedule(s) referred to in these conditions shall mean the relevant schedule(s) annexed to the tender papers or the standard Schedule of Rates of the government mentioned in Schedule 'F' hereunder, with the amendments thereto issued upto the date of receipt of the tender.
- x) Department means Guru Gobind Singh Indraprastha University or authorized by GGSIPU to work on their behalf.
- xi) District Specifications means the specifications followed by the State Government in the area where the work is to be executed.
- xii) Tendered value means the value of the entire work as stipulated in the letter of award.

### **Scope and Performance**

- 3. Where the context so requires, words imparting the singular only also include the plural and vice versa. Any reference to masculine gender shall whenever required include feminine gender and vice versa.
- 4. Headings and Marginal notes to these General Conditions of Contract shall not be deemed to form part thereof or be taken into consideration in the interpretation or construction thereof or of the contract.
- 5. The contractor shall be furnished, free of cost one certified copy of the contract documents except standard specifications, Schedule of Rates and such other printed and published documents, together with drawings as may be forming part of the tender papers. None of these documents shall be used for any purpose other than that of this contract.

### Works to be carried out

6. The work to be carried out under the Contract shall, except as otherwise provided in these conditions, include all labour, materials, tools, plants, equipment and transport which may be required in preparation of and for and in the full and entire execution and completion of the works. The descriptions given in the Schedule of Quantities (Schedule-A) shall, unless otherwise stated, be held to include wastage on materials, carriage and cartage, carrying and return of empties, hoisting, setting, fitting and fixing in position and all other labours necessary in and for the full and entire

execution and completion of the work as aforesaid in accordance with good practice and recognized principles.

### **Sufficiency of Tender**

7. The Contractor shall be deemed to have satisfied himself before tendering as to the correctness and sufficiency of his tender for the works and of the rates and prices quoted in the Schedule of Quantities, which rates and prices shall, except as otherwise provided, cover all his obligations under the Contract and all matters and things necessary for the proper completion and maintenance of the works.

### **Discrepancies and Adjustment of Errors**

- 8. The several documents forming the Contract are to be taken as mutually explanatory of one another, detailed drawings being followed in preference to small scale drawing and figured dimensions in preference to scale and special conditions in preference to General Conditions.
  - 8.1 In the case of discrepancy between the schedule of Quantities, the Specifications and/or the Drawings, the following order of preference shall be observed:
    - i) Description of items given in Schedule of Quantities.
    - ii) Technical Specification and Special Conditions.
    - iii) Drawings.
    - iv) C.P.W.D. Specifications.
    - v) Indian Standard Specifications of B.I.S.
    - vi) Decision of Engineer-in-Charge.
  - 8.2 If there are varying or conflicting provisions made in any one document forming part of the contract, the Accepting Authority shall be the deciding authority with regard to the intention of the document and his decision shall be final and binding on the contractor.
  - 8.3 Any error in description, quantity or rate in Schedule of Quantities or any omission there from shall not vitiate the Contract or release the Contractor from the execution of the whole or any part of the works comprised therein according to drawings and specifications or from any of his obligations under the contract.

# Form of Performance Security (Guarantee) Bank Guarantee Bond

1.	In consideration of the Guru Gobind Singh Indraprastha University (hereinafter called "The University") having offered to accept the terms and conditions of the proposed agreement between and (hereinafter called "the said
	Contractor(s)") for the work (hereinafter called "the said agreement") having agreed to production of a irrevocable Bank Guarantee for Rs (Rupees only) as a security/guarantee from the contractor(s) for compliance of his obligations in accordance with the terms and condition
	in the said agreement.
	We, (hereinafter referred as "the Bank") hereby undertake to (indicate the name of the Bank)
	pay to the University an amount not exceeding Rs (Rupees only) on demand by the University.
2.	We, do hereby undertake to pay the amounts due and (indicate the name of the Bank)
	payable under this guarantee without any demure, merely on a demand from the University stating that the amount claimed is required to meet the recoveries due or likely to be due from the said contractor(s). Any such demand made on the bank shall be conclusive as regards the amount due and payable by the bank under this Guarantee. However, our liability under this guarantee shall be restricted to an amount not exceeding Rs.————————————————————————————————————
3.	We, the said bank further undertake to pay the University any money so demanded notwithstanding any dispute or disputes raised by the contractor(s) in any suit or proceeding pending before any court or Tribunal relating thereto, our liability under this present being absolute and unequivocal.
	The payment so made by us under this bond shall be a valid discharge of our liability for payment there under and the Contractor(s) shall have no claim against us for making such payment.
4.	We, further agree that the guarantee herein contained shall (indicate the name of the Bank)
	remain in full force and effect during the period that would be taken for the performance of the said agreement and that it shall continue to be enforceable till all the dues of the University under or by virtue of the said agreement have been fully paid and its claims satisfied or discharged or till Engineer-in-Charge on behalf of the University certified that the terms and conditions of the said agreement have been fully and properly carried out by the said Contractor(s) and accordingly discharges this guarantee.
5.	We, further agree with the University that the University (indicate the name of the Bank)
	shall have the fullest liberty without our consent and without affecting in any manner our obligation hereunder to vary any of the terms and conditions of the said agreement or to extend time of performance by the said Contractor(s) from time to time or to postpone for any time or from time to time any of the powers exercisable by the University against the said contractor(s) and to forbear or enforce any of the terms and conditions relating to the said agreement and we shall not be relieved from our liability by reason of any such variation, or extension being granted to the said Contractor(s) or for any forbearance, act of omission on

6.	This guarantee will not be discharged due to the change in the constitution of the Bank or the Contractor(s).
7.	We,lastly undertake not to revoke this guarantee except (indicate the name of the Bank) with the previous consent of the University in writing.
8.	This guarantee shall be valid upto unless extended on demand by the University. Notwithstanding anything mentioned above, our liability against this guarantee is restricted to Rs (Rupees only) and unless a claim in writing is lodged with us within six months of the date of expiry or the extended date of expiry of this guarantee all our liabilities under this guarantee shall stand discharged.
	Dated the day of for (indicate the name of the Bank)

this provision, have effect of so relieving us.

the part of the University or any indulgence by the University to the said Contractor(s) or by any such matter or thing whatsoever which under the law relating to sureties would, but for

Signature & Seal of Bank

### FORM OF EARNEST MONEY (BANK GUARANTEE)

WHEREAS, contractor (Name of contractor) hereinafter called "the
contractor") has submitted his tender dated(date) for the construction of
(name of work) (hereinafter called "the Tender")
KNOW ALL PEOPLE by these presents that we
bank) having our registered office at (hereinafter called "the
Bank") are bound unto
Engineer) (hereinafter called "the Engineer-in-Charge") in the sum of Rs
(Rs. In words) for which payment well and truly to be made to
the said Engineer-in-Charge the Bank binds itself, his successors and assigns by these presents.
SEALED with the Common Seal of the said Bank this
THE CONDITIONS of this obligation are:

- (1) If after tender opening the Contractor withdraws his tender during the period of validity of tender (including extended validity of tender) specified in the Form of tender;
- (2) If the contractor having been notified of the acceptance of his tender by the Engineer-in-Charge:
  - a) fails or refuses to execute the Form of agreement in accordance with the instructions to contractor, if required; OR
  - b) fails or refuses to furnish the Performance Guarantee, in accordance with the provisions of tender document and instructions to contractor, OR
  - fails or refuses to start the work, in accordance with the provisions of the contract and instructions to contractor, OR
  - d) fails or refuses to submit fresh Bank Guarantee of an equal amount of this Bank Guarantee, against Security Deposit after award of contract.

We undertake to pay to the Engineer-in-Charge up to the above amount upon receipt of his first written demand, without the Engineer-in-Charge having to substantiates his demand, provided that in his demand the Engineer-in-Charge will note that the amount claimed by him is due to him owing to the occurrence of one or any of the above conditions, specifying the occurred condition or conditions.

The Guarantee will remain in force up to and including the date\*...... after the deadline for submission of tender as such deadline is stated in the instructions to contractor or as it may be extended by the Engineer-in-Charge, notice of which extension(s) to the Bank is hereby waived. Any demand in respect of this Guarantee should reach the Bank not later than the above date.

DATE..... SIGNATURE OF THE

**SEAL** 

**BANK** 

WITNESS......
(SIGNATURE, NAME AND ADDRESS

<sup>\*</sup> Date to be worked out on the basis of validity period of 6 months from last date of receipt of tender.

### PROFORMA OF SCHEDULES

(Operative Schedules to be supplied separately to each intending tenderer)

SCHEDULE 'A'

Schedule of quantities - As per Vol-II (Page 39 to 45)

SCHEULE 'B'

Schedule of materials to be issued to the contractor. NIL

**SCHEDULE 'C'** 

Tools and plants to be hired to the contractor: NIL

SCHEDULE 'D'

Extra schedule for specific requirements/ document for the work, if any. - NIL

SCHEDULE 'E'

Reference to General Conditions of contract.

Name of Work: A/A at GGSIP University, Dwarka Campus, New Delhi

**Sub Head:** Construction of 3 Nos. Sheds for Centre of USMC

Department. (Sub head :- Electrical Works)

Estimated cost of work: Rs. 1005467/-

i) Earnest money: Rs. 20109/-

ii) Performance Guarantee: 5% of tendered value.iii) Security Deposit : 5% of tendered value.

SCHEDULE 'F'

General Rules & Directions:

Officer Inviting Tender: Ex Engr, UWD, GGSIPU

**Definitions:** 

2(v) Engineer-in-Charge Ex Engr, UWD, GGSIPU

2(viii)Accepting Authority EE, UWD, GGSIPU

2(x) Percentage on cost of materials and labour

to cover all overheads and profits 15%

2(xi) Standard Schedule of Rates DSR(E)' 2012

2(xii) Department GGSIPU

9(ii) Contract Form CPWD Form 8 as modified up to date of

receipt of tender.

#### Clause 1

i) Time allowed for submission of Performance Guarantee from the date of issue of letter of acceptance, in days 7 days

ii) Maximum allowable extension with late fee @ 0.1 % per day Of Performance Guarantee amount beyond the period 3 days provided in (i) above

### Clause 2

Authority for levy compensation Superintending Engineer, **GGSIPU** Under clause 2.

Clause 2A

Whether Clause 2A shall be applicable No.

Clause 5

Number of days from the date of issue of letter of acceptance for reckoning date of start 10 days

Time allowed for execution of work. 60 days

Authority to give fair and reasonable Superintending Engineer, GGSIPU extension of time for completion of work

Clause 6 or 6 A Clause Applicable **6A** 

Clause 7

Gross work to be done together with net payment/ Adjustment of advances for material collected, if any Since the last such payment for being eligible to Interim payment

Clause 10 A

List of testing equipment to be provided at site Magger, Crimping Tool, Hammer Drill Machine, Chase Cutter, Tong Tester.

Rs. 3 Lakh

Clause 10 B(ii)

Whether clause 10B(ii) is applicable No

Clause 10 C

Component of labour expressed as percent Not Applicable

of value of work

Clause 10 CA Not Applicable

Clause 10 CC


Clause 10CC to be applicable in contracts with Not Applicable Stipulated period of completion exceeding the

Period shown in next column

Component of Covered under of	mponent of other materials, labour, POL Civil (except for materials clause 10CA) / Electrical aterials expressed as percent f work	etc for price escalationNil			
Component of lof total value of	abour expressed as percent f work	Nil			
Component of l Of total value o	POL expressed as percent f work	Nil			
Clause 11 Specifications to be followed execution of work		CPWD specifications for Electrical Work for 2013 (Part –I, Internal) & 1994 (Part – II, External) & with upto date amendments			
Clause 12 12.2 & 12.3	Deviation limit beyond which clauses 12.2 & 12.3	30%			
12.5	Deviation limit beyond which clauses 12.2 & 12.3 shall apply for foundation Work	Not Applicable			
Type of work		Original work			
Clause 16 Competent Authority for deciding reduced rates		Superintending Engineer, GGSIPU			
To be deploye Clause 36(i)	tory machinery tools& plants d by the contractor at site of Technical representative(s) rate	As required for completion within time period			

S.No	Requirement	Nos.	Qualification			Rate	of
						Recovery	
1.	Technical Representative	1	Graduate	Engineer	in	Rs. 25,000/-	per
			Electrical/	Mechan	ical	month	
			OR				
			Diploma Engineer in				
			Electrical/Mechanical with 5				
			vears experience.				

Clause 42 Not Applicable

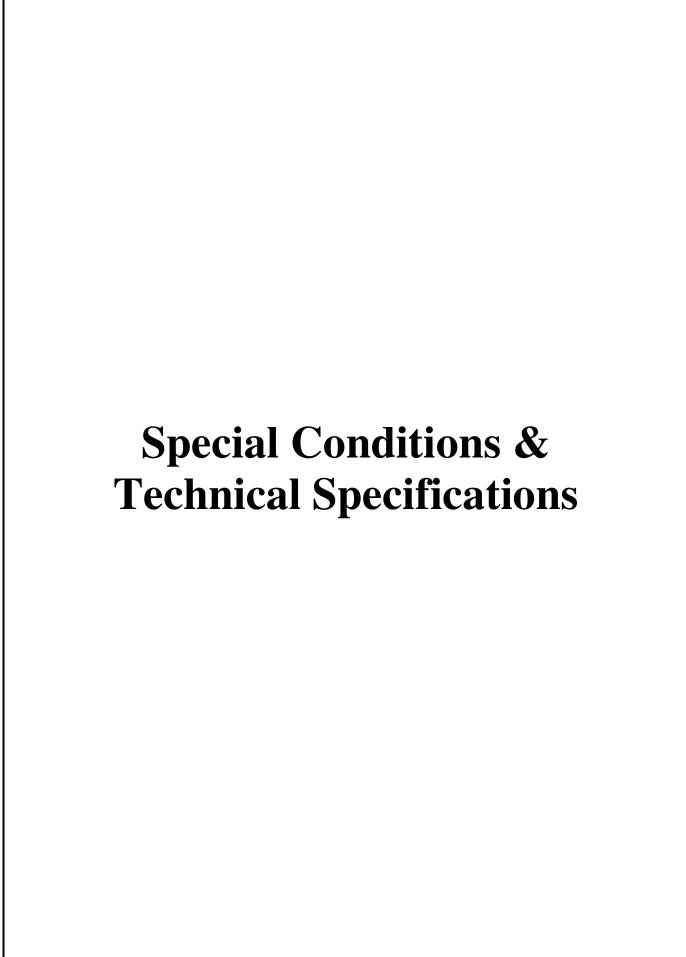

### **Special Conditions**

- 1.0 "CPWD Specifications" wherever appearing in this document would mean Latest edition of CPWD specifications with correction slips issued upto the last date of receipt of tender.
- 2.0 GCC 2010 referred in this document is Govt of India Publication and is available in the market.
  - a) In CPWD Form 8, General Rules and Directions and Conditions of Contract forming part of 'GCC 2010' shall be superceeded by this document.
  - b) Wherever "President of India" is appearing in the GCC 2010 same shall be read as GGSIPU.
  - c) Wherever Superintending Engineer or Chief Engineer is appearing in GCC 2010, it may be read as Superintending Engineer, GGSIPU or Chief Engineer, GGSIPU.
  - d) Wherever CPWD or PWD is appearing in GCC 2010, it may be read as GGSIPU.
- 3.0 Unless otherwise provided in the schedule of quantities the rates tendered by the contractor shall be all-inclusive and shall apply to all heights, levels, depths, leads, lifts including shafts, machine room & stair cases. The rates for all items of work, unless clearly specified otherwise, shall include the cost of all labour, materials, and other inputs involved in the execution of the items.
- 4.0 No foreign exchange shall be made available by the department for the purpose of procurement of equipment, plants, machinery, materials of any kind or any other items required to be carried out in execution of work.
- 5.0 The contractor or his authorized representative should always be available at the site of work to take instructions from Engineer in charge, and ensure proper execution of work.
- 6.0 No work shall commence in the absence of contractor's engineers and they shall certify in writing about the correctness of layout alignment and shall ensure stability of all structural work such as partition panel and other related items.
- 7.0 All work and materials brought and left upon the ground by the contractor or by his orders for the purpose of forming part of the works, are to be considered to be the property of the GGSIPU and the same are not to be removed or taken away by the contractor or any other person without consent in writing of the Engineer-in-charge but the GGSIPU is not to be in any way responsible for any loss or damage which may happen to or in respect of any such work or materials either by the same being lost or damaged by weather or otherwise.
- 8.0 The contractor shall execute the different items simultaneously, as far as possible, so that minimum breakage and repairs are involved.

- 9.0 The contractor shall take all necessary precautions to prevent any nuisance or inconvenience to the owners, tenants of adjacent properties and to the public in general and to prevent any damage to such properties and any pollution of environment and waterways. He shall make good at his own cost and to the satisfaction of the Engineer-in-Charge, any damage to public or private property whatsoever caused by the execution of the work or by traffic brought thereon by the contractor. Utmost care shall be taken to keep the noise level to the barest minimum so that no disturbance as far as possible is caused to the occupants/users of adjoining buildings.
- 10.0 The contractor shall be responsible for watch and ward of all the works, equipment and various materials till complete handing over of works.
- 11.0 Wherever any reference to any Indian Standards Specification occurs in the documents relating to this contract the same shall be inclusive of all amendments issued their to or revisions there of if any, upto the date of receipt of tenders.
- 12.0 Cess @ 1% of gross value of work done shall be deducted from the payment as per Delhi Building & other Construction Workers Welfare Cess Act 1996 besides other statutory deduction like income tax, VAT etc.
- 13.0 The rates quoted by the contractor shall be all inclusive keeping in mind the specifications, special conditions and technical specifications and nothing extra shall be payable whatsoever, unless otherwise specified.
- 14.0 If the work is carried out in more than one shifts or during night to meet the time period of completion, nothing extra shall be paid on this account.
- 15.0 The contractor shall be bound to follow the instruction and restrictions imposed by the Administration / Police authorities on the working and movement of labour / material / vehicles etc and nothing extra shall be paid on this account.
- 16.0 All the materials are to be got approved from the Engineer-in-Charge before using the same in the work.
  - 17.0 The electrical work will be carried out in accordance with the General Specifications 2013 for electrical works in (part I) internal, CPWD specifications 1994 (part II) external, except as otherwise specified in the description of items given in the Schedule of Quantities or in the attached Technical Specification while complying in all respects with the requirements of the latest Indian Electricity Rules in force at the time of execution.
  - 18.0 The electrical work shall be carried out simultaneously with the civil and interior works.
- 19.0 If any minor alterations are found necessary, the contractor shall do the same within tendered rates.

- 20.0 The contractor shall employ adequate labour to complete the work within the stipulated time and make his own arrangements for storage of materials etc.
- 21.0 All tender rates will include the cost of materials, erection, connections, labour, supervision, tools, plant, transport, all taxes, duties, contingencies, breakage, wastage, sundries, i.e. should be for an item complete in all respects.

**EE/UWD** 

### **LIST OF APPROVED MATERIALS**

- 1. The Contractor shall obtain prior approval from the Engineer-in-charge before placing order for any specific material.
- 2. Wherever applicable, the Engineer-in-charge may approve any material equivalent to that specified in the tender subject to proof being offered by the Contractor for equivalence to his satisfaction.


In case on non availability of the brand specified in the contract, the Contractor shall submit the documentary evidence of non availability of approved brand and suggest the alternate brand of equivalent quality for the approval of the competent authority. It will be at the discretion of the Engineer-in-Charge to approve or reject the brand suggested by the contractor and approve the name of any other equivalent brand.

3. Unless otherwise specified, the brand/make of the material as specified in the item nomenclature, in the particular specifications and in the list of approved materials attached in the tender, shall be used in the work.

S. No.	Description of Items	Approved Makes
1.	Copper wire FRLS/Al. conductor armoured cable.	Sky tone/ Havells/ National (N.C) / Finolex
2.	Telephone Cable	Delton/Skytone/Havells
3.	Steel conduit	BEC/Steel Kraft/NIC
4.	PVC Conduit	BEC/AKG/Kalinga
5.	Modular Switches/Sockets/Tel. sockets/ / Fan Regulator	Legrand(Mosaic)/ Crabtree (Athena) or equivalent model of M.K.
6.	MCB/ MCB DB/Industrial socket	Legrand /L&T (Hagger)/ GE/ ABB/Schneider
7.	MCCB	GE spectra TM or equivalent model in ABB/Schneider
8.	Mirror optics CFL fittings with electronic ballast & lamp	Bajaj model no. BMLA 01 236 CFL WEB 2/Wipro model WVP 24236SGW/Philips FBS 300/236 P5HF
9.	2 X 18 W CFL down light fixture with electronic ballast & lamp	Philips FBH150 M 2xPL- C/4P18WT HF/GE CFLC2 x 18DN R(H) HF/ Surya SDLHR 218 CF TR EB2/P0

10.	1 X 36 W box type surface mounting fitting with electronic ballast & lamp	Philips TMS021 1 x TLD36W EBT /Wipro model WCF 12136SGW/ BJIR136/140WEB1
11.	1 x 50 W, 12 Volt, halogen down light luminaire.	Philips QBS051 Max50W- GU5.3 12V WH IN with ETK- 50 Transformer or equivalent model in Bajaj, Wipro
12.	CFL Bulk head fitting with lamp	Philips FXC101 1xPL-S /2P 9W AC GR/ Wipro WKP14109/Bajaj BJBE19
13.	1 X 70 W Metal Halide fitting with lamp	Bajaj BGEMF70SV/MHSE or equivalent model in Philips/Wipro
14.	Mirror Light	Decon 29CF or equivalent model in Ankur.
15.	Geyser	Racold (Eterno model) or equivalent model of Venus/Havells
16.	Moulded SMC box	Sintex, Hansel.
17.	Telephone Tag Block	Krone or equivalent
18.	1400mm Sweep Ceiling fans	Havells(Velocity)/Bajaj (Pride)/CG(High Speed)
19.	Wall mounted fans	CG/Havells/Bajaj
20.	Exhaust fans	CG/Havells/Bajaj
21.	Hand Dryer	Avro model no. HD 03 or equivalent.

EE/UWD

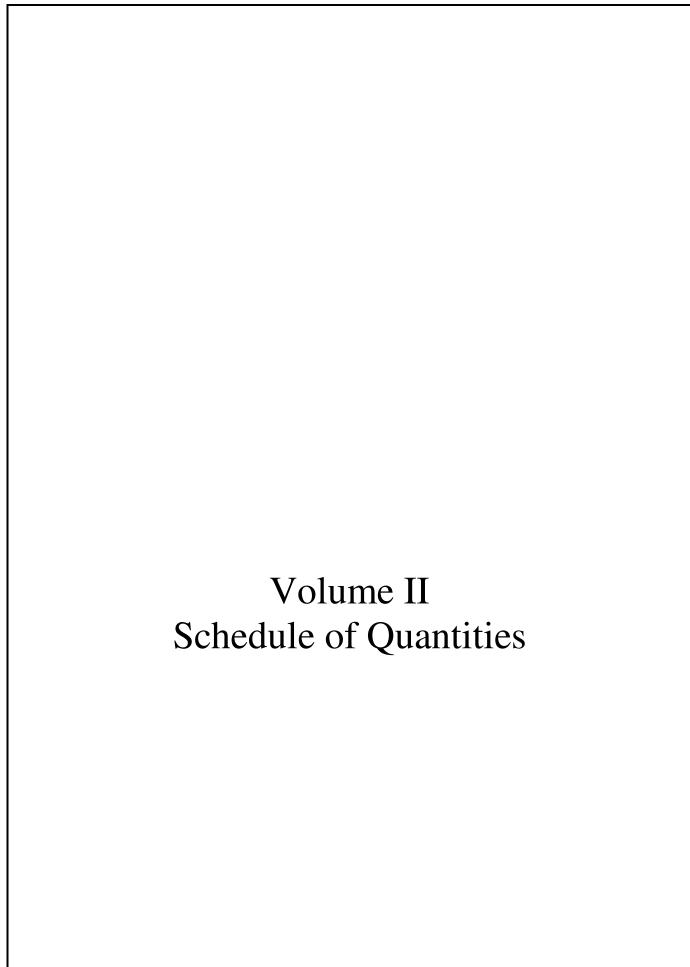

## Schedule of Quantities

Name of Work: A/A at GGSIP University, Dwarka Campus, New

Delhi

Sub Head: Construction of 3 Nos. Sheds for Centre of USMC

Department (Sub Head :- Electrical Works)

S. No.	Description of work	Qty	Unit	Rate (Rs./Unit)	Amount in Rs/-
	ad 1:- Internal Electrical Wiring, Telephone a points				
1.1	Wiring for light point/ fan point/ exhaust fan point/ call bell point with 1.5 sq.mm FRLS PVC insulated copper conductor single core cable in surface / recessed steel conduit, with modular switch, modular plate, suitable GI box and earthing the point with 1.5 sq.mm. FR PVC insulated copper conductor single core cable etc as required.				
	Group C	109	Point		
1.2	Wiring for light/ power plug with 2X4 sq. mm FRLS PVC insulated copper conductor single core cable in surface/ recessed steel conduit alongwith 1 No 4 sq. mm FR PVC insulated copper conductor single core cable for loop earthing as required.	200	Metre		
1.3	Wiring for light/ power plug with 4X4 sq. mm FRLS PVC insulated copper conductor single core cable in surface/ recessed steel conduit alongwith 2 Nos 4 sq. mm FR PVC insulated copper conductor single core cable for loop earthing as required.	175	Metre		
1.4	Supplying and drawing following sizes of FRLS PVC insulated copper conductor, single core cable in the existing surface/recessed steel/ PVC conduit as required.				
	a) 3 x 1.5 sq. mm	125	Metre		
	b) 6 x 1.5 sq. mm	50	Metre		
1.5	Supplying and drawing following pair 0.5 sq mm FR PVC insulated annealed copper conductor, unarmored telephone cable in the existing surface/ recessed steel/ PVC conduit as required.				
	4 Pair	90	Metre		
1.6	Supplying and fixing of following sizes of steel conduit along with accessories in surface/recess including painting in case of surface conduit, or cutting the wall and making good the same in case of recessed conduit as required.				
	a) 20 mm	175	Metre		
	b) 25 mm	10	Metre		
1.7	Supplying and fixing of following sizes of medium class PVC conduit along with accessories in surface/recess including				

	cutting the wall and making good the same in case of recessed conduit as required.			
	a) 25 mm	290	Metre	
1.8	Supplying and fixing following size/ modules, GI box alongwith modular base & cover plate for modular switches in recess etc as required.	230		
	a) 1 or 2 Module (75mmX75mm)	31	Each	
	b) 3 Module	5	Each	
	c) 4 Module	8	Each	
	d) 12 Module	13	Each	
1.9	Supplying and fixing following modular switch/ socket on the existing modular plate & switch box including connections but excluding modular plate etc. as required.			
	a) 5/6 Amps. Switch	28	Each	
	b) 15/16 Amps. Switch	35	Each	
	c) 3 pin 5/6 Amps. Socket outlet	28	Each	
	d) 6 pin 15/16 Amps. Socket outlet	35	Each	
	e) Telephone socket outlet	12	Each	
1.10	Supply and fixing suitable size GI box with moduler plate and cover in front on surface or in recess, including providing and fixing 6 pin 5/6 & 15/16 Amps. Modular socket outlet and 15/16 Amps. Modular switch, connection etc. as required.	26	Each	
1.11	Supplying and fixing stepped type electronic fan regulator on the existing modular plate switch box including connections but excluding modular plate etc. as required.	27	Each	
1.12	Supplying and fixing 20 amps, 240 volts, SPN industrial type, socket outlet, with 2 pole and earth, metal enclosed plug top alongwith 20 amps "C" curve, SP, MCB, in sheet steel enclosure, on surface or in recess, with chained metal cover for the socket out let and complete with connections, testing and commissioning etc. as required.	19	Each	
1.13	Supplying and fixing following ways surface/ recess mounting, vertical type, 415 volts, TPN MCB distribution board of sheet steel, dust protected, duly powder painted, inclusive of 200 amps tinned copper bus bar, common neutral link, earth bar, din bar for mounting MCB's, with provision of 100/125 amps TP 16 KA MCCB as incomer, interconnection between incomer MCCB and bus bars (but without MCB's/ MCCB) as required. (Note: Vertical type MCB TPDB is normally used where 3 phase outlets are required)			
	a) 4 Way TP	3	Each	
	b) 8 Way TP	1	Each	
1.14	Supplying and fixing following way, single pole and neutral, sheet steel, MCB distribution board, 240 volts, on surface/recess, complete with tinned copper bus bar,			

	neutral bus bar, earth bar, din bar,			
	interconnections, powder painted including			
	earthing etc. as required. (But without			
	MCB/RCCB/Isolator)			
	a) 2 + 8 way, Double door	_		
		2	Each	
1.15	Supplying and fixing 5 amps to 32 amps			
	rating, 240/415 volts,			
	"C" curve, miniature circuit breaker suitable			
	for inductive load of following poles in the			
	existing MCB DB complete with connections,			
	testing and commissioning etc. as required.			
	a) Single pole	76	Each	
	b) Double Pole	2	Each	
1.16	Providing and fixing following rating and		Lacii	
1.16				
	breaking capacity MCCB in existing cubicle			
	panel board including drilling holes in cubicle			
	panel, making connections, etc. as required.			+
	a) 100 Amp, 16 KA, TP	3	Each	
	b) 125 Amp, 16 KA, TP	1	Each	
1.17	Supplying and fixing 63 Amps. Rating, 415			
	Volts, Tripple pole "C" curve, miniature circuit			
	breaker suitable for inductive load of following			
	poles in the existing MCB DB complete with			
	connection, testing and commissioning etc.			
	as required.	2	Each	
1.18	S/F of 2 module, Category 6 RJ 45 socket			
	outlet for internet point on the existing			
	modular plate/box complete as required.	16	Each	
1.19	Supply and fixing of M.S. fan hook,clamp			
	type for fixing on M.S. channel complete as			
	required as per instruction of Engineer-in -			
	charge.	27	Each	
Sub He	ad 2:- Fan, Fittings & Fixtures			
2.1	Supplying and Installation of following sweep,			
۷.۱	230 volt AC, 50 HZ ceiling fan complete with			
	all accessories like blades, down rods,			
	canopies, shackle etc, as required and as per			
	direction of Engineer-in-charge.			
	a) 1400 mm sweep size	27	Each	
2.2	S/F wall mounted fan 400mm sweep,			
	complete with blades, wire mesh guard,	_		
	oscillating type complete as required.	5	Each	
2.3	Supplying and fixing of following size of			
	exhaust fans, 1400 r.p.m., 230V, A.C. supply,			
	heavy duty, complete with G.I. louvers on			
	existing opening including making connection			
	etc. as reqd.			
	a) 300mm	2	Each	
2.4	Supplying and installation of 1 X 36 watt			
	surface mounted box type fitting with			
	Electronic Ballast complete with fluorescent			
	tube etc. as required.	11	Each	
2.5	S/F of 2X36 watts CFL fitting recessed	- ' '		
2.0	mounting type with square paralite P5 louver			
	block in metalic frame and all accessories like			
	CFL tubes, electronic ballast, internal wiring	56	Each	
L	or Libbes, electronic ballast, internal willing	50	Lacii	

	etc. complete in existing false ceiling, suitable			
	for operation on 220 V A.C. supply i/c P/F			
	wire, metalic flexible conduit, nut bolts,			
	metalic chain etc. and testing complete as			
	required.			
0.0				
2.6	Supplying and fixing of 1000 W,			
	2 module, Dimmer on the existing modular			
	plate & switch box including connections but			
	excluding modular plate etc. as required.	1	Each	
2.7	S/F of 2 X18 watts recessed mounting type			
2.7				
	down light fixture, complete with all			
	accessories like CFL lamp, electronic ballast,			
	internal wiring etc. in existing false ceiling,			
	including P/Fconnecting wire, nut bolts,			
	metalic chain with suitable suspension			
	arrangement from ceiling etc. and testing			
	complete as requiredand as per direction of	•		
	Engineer-in-charge.	8	Each	
2.8	Supply and fixing of 1 x 50 W, 12 Volt, low			
	voltage halogen dichoric down light luminaire,			
	recess mounting type complete with all			
	accessories like 50 W halogen lamp,			
	transformer, internal wiring etc. in existing			
	false ceiling including making connection	•		
	complete as required.	6	Each	
2.9	Supplying and fixing bulk head fitting suitable			
	for 9 watt CFL complete with lamp etc, as			
	required.	19	Each	
2.10	Supply & fixing Mirror light double stairway			
2.10		1	Each	
	with 2X13 W spiral CFL as required.	1	Lacii	
2.11	Supply & Instalation of storage type			
	automatic electric closed water heater			
	(Geyser) in plastic body comprising of inner			
1				
	container made of heavy duty steel sheet			
	container made of heavy duty steel sheet coplete with heating element,			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug,			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd.			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C.			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd.			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C.			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical	1	Fach	
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.	1	Each	
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220	1	Each	
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic	1	Each	
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of	1	Each	
2.12	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic	1	Each Each	
-	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.			
2.12 2.13	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded			
-	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm			
-	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC			
-	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with			
-	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No.			
-	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with			
-	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No. GSJB – 2817 complete with suitable length			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No. GSJB – 2817 complete with suitable length 63 amps. Aluminiun strip for connection of			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No. GSJB – 2817 complete with suitable length 63 amps. Aluminiun strip for connection of phase and neutral,insulator and 1No. 6-			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No. GSJB – 2817 complete with suitable length 63 amps. Aluminiun strip for connection of phase and neutral,insulator and 1No. 6-32amps. SP, C-series MCB including			
	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No. GSJB – 2817 complete with suitable length 63 amps. Aluminiun strip for connection of phase and neutral,insulator and 1No. 6-32amps. SP, C-series MCB including connection,testing and commissioning as	1	Each	
2.13	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No. GSJB – 2817 complete with suitable length 63 amps. Aluminiun strip for connection of phase and neutral,insulator and 1No. 6-32amps. SP, C-series MCB including connection,testing and commissioning as required.			
-	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No. GSJB – 2817 complete with suitable length 63 amps. Aluminiun strip for connection of phase and neutral,insulator and 1No. 6-32amps. SP, C-series MCB including connection,testing and commissioning as	1	Each	
2.13	container made of heavy duty steel sheet coplete with heating element, (ISI),thermostate, indication lamp, drain plug, vent pipe pressure relief valve, with suitable size 3 core flexible cable etc. as reqd. suitable for 230 volts single phase 50 c/s A.C. supply and of following capacity in vertical model ISI marked.  a) 15 Ltrs.  S/I/T/C of Automatic Hand Dryer 1650 W, 220 V, a.c. with hot and cold function in plastic body complete as required as per direction of Engineer-in-Charge.  Supplying and fixing of hot press moulded SMC box (Connection box) 280mm X 170mm X 130mm complete with SMC base and SMC door fixed with higes on left or right side with machine fasteners of Sintex make cat. No. GSJB – 2817 complete with suitable length 63 amps. Aluminiun strip for connection of phase and neutral,insulator and 1No. 6-32amps. SP, C-series MCB including connection,testing and commissioning as required.	1	Each	

approved steel primer using structural steel etc. as required.  a) In grating frames, guard bar, ladder raillings, brackets, gates and similar works.  2.15 Supply and fixing of 1X 70 W, asymmetrical beam integral metal Halide flood light luminaire with Grey powder coated die cast aluminium housing, built in control gear, aluminium reflector, heat resistant toughned glass cover, 70 W MH(T) lamp and accessories complete on existing angle iron frame including making connection of fitting, testing and commissioning complete as required.  Sub Head 3:- Cables  3.1 Laying of one number PVC insulated and PVC sheathed/ XLPE power cable direct in ground including excavation, sand cushioning, propective covering and refilling the trench etc, as required.  a) upto 35 sgmm and upto 95 sgmm 40 Metre  b) above 35 sgmm and upto 95 sqmm 40 Metre  3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sgmm 60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sgmm 70 Metre  3.4 Laying of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sgmm (clarified with 1 mm thick saddle.)  70 Metre  3.4 Laying of one number PVC insulated and		1 1.1 1 1 1 1 1 1 1 1 1				
a) In grating frames, guard bar, ladder railings, brackets, gates and similar works.  2.15 Supply and fixing of 1X 70 W, asymmetrical beam integral metal Halide flood light luminaire with Grey powder coated die cast aluminium housing, built in control gear, aluminium reflector, heat resistant toughned glass cover, 70 W MH(T) lamp and accessories complete on existing angle iron frame including making connection of fitting, testing and commissioning complete as required.  3.1 Laying of one number PVC insulated and PVC sheathed/ XLPE power cable direct in ground including excavation, sand cushioning, propective covering and refilling the trench etc, as required.  a) upto 35 sqmm 100 Metre  b) above 35 sqmm and upto 95 sqmm 40 Metre  3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm 60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.) 70 Metre  b) above 35 sqmm and upto 95 sqmm 7 Metre  3.4 Laying of one number PVC insulated and						
2.15 Supply and fixing of 1X 70 W, asymmetrical beam integral metal Halide flood light luminaire with Grey powder coated die cast aluminium housing, built in control gear, aluminium reflector, heat resistant toughned glass cover, 70 W MH(T) lamp and accessories complete on existing angle iron frame including making connection of fitting, testing and commissioning complete as required.  Sub Head 3:- Cables  3.1 Laying of one number PVC insulated and PVC sheathed/ XLPE power cable direct in ground including excavation, sand cushioning, propective covering and refilling the trench etc, as required.  a) upto 35 sqmm 100 Metre b) above 35 sqmm and upto 95 sqmm 40 Metre  3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required. a) upto 35 sqmm 60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required. a) upto 35 sqmm (clarified with 1 mm thick saddle.) 70 Metre b) above 35 sqmm and upto 95 sqmm 7 Metre		a) In grating frames, guard bar, ladder	60.00	Ka		
Sub Head 3:- Cables  3.1	2.15	Supply and fixing of 1X 70 W, asymmetrical beam integral metal Halide flood light luminaire with Grey powder coated die cast aluminium housing, built in control gear, aluminium reflector, heat resistant toughned glass cover, 70 W MH(T) lamp and accessories complete on existing angle iron frame including making connection of fitting, testing and commissioning complete as				
3.1 Laying of one number PVC insulated and PVC sheathed/ XLPE power cable direct in ground including excavation, sand cushioning, propective covering and refilling the trench etc, as required.  a) upto 35 sqmm  b) above 35 sqmm and upto 95 sqmm  Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm  Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  b) above 35 sqmm and upto 95 sqmm  7 Metre  Laying of one number PVC insulated and	Sub He		-	Lacii		
PVC sheathed/ XLPE power cable direct in ground including excavation, sand cushioning, propective covering and refilling the trench etc, as required.  a) upto 35 sqmm  100 Metre  b) above 35 sqmm and upto 95 sqmm  3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm  60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  b) above 35 sqmm and upto 95 sqmm  7 Metre  3.4 Laying of one number PVC insulated and						
ground including excavation, sand cushioning, propective covering and refilling the trench etc, as required.  a) upto 35 sqmm  b) above 35 sqmm and upto 95 sqmm  40 Metre  3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm  60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  70 Metre  b) above 35 sqmm and upto 95 sqmm  7 Metre	0.1					
the trench etc, as required.  a) upto 35 sqmm  b) above 35 sqmm and upto 95 sqmm  3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm  60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  b) above 35 sqmm and upto 95 sqmm  7 Metre  3.4 Laying of one number PVC insulated and		ground including excavation, sand				
a) upto 35 sqmm b) above 35 sqmm and upto 95 sqmm 40 Metre  3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm 60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.) 70 Metre  b) above 35 sqmm and upto 95 sqmm 7 Metre  3.4 Laying of one number PVC insulated and						
b) above 35 sqmm and upto 95 sqmm  3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm  60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  70 Metre  b) above 35 sqmm and upto 95 sqmm  7 Metre			100			
3.2 Laying of one number additional PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm  60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  70 Metre  b) above 35 sqmm and upto 95 sqmm  7 Metre  3.4 Laying of one number PVC insulated and		, , , ,				
insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and refilling the trench etc, as required.  a) upto 35 sqmm  60 Metre  3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  70 Metre  b) above 35 sqmm and upto 95 sqmm  7 Metre  3.4 Laying of one number PVC insulated and	3 0		40	Metre		
3.3 Laying and fixing of one number PVC insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  b) above 35 sqmm and upto 95 sqmm  7 Metre  3.4 Laying of one number PVC insulated and	5.2	insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size direct in ground in the same trench in one tier horizontal formation including excavation, sand cushioning, protective covering and				
insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.  a) upto 35 sqmm (clarified with 1 mm thick saddle.)  b) above 35 sqmm and upto 95 sqmm 7 Metre  3.4 Laying of one number PVC insulated and		a) upto 35 sqmm	60	Metre		
saddle.)  b) above 35 sqmm and upto 95 sqmm  7 Metre  3.4 Laying of one number PVC insulated and	3.3	insulated and PVC sheathed/XLPE power cable of 1.1 KV grade of following size of wall surface as required.				
3.4 Laying of one number PVC insulated and		saddle.)	70	Metre		
			7	Metre		
grade of following size in the existing RCC/Hume/Metal Pipe as required.	3.4	PVC sheathed/XLPE powercable of 1.1 KV grade of following size in the existing RCC/Hume/Metal Pipe as required.				
a) upto 35 sqmm 30 Metre		,	30	Metre		
b) above 35 sqmm and upto 95 sqmm 3 Metre		, , , , , , , , , , , , , , , , , , , ,	3	Metre		
3.5 Providing and fixing 6 SWG dia G.I. wire on surface or in recess for loop earthing along with existing surface/recessed conduit/ sub main wiring /cable, as required.  400 Metre	3.5	surface or in recess for loop earthing along with existing surface/recessed conduit/ sub	400	Metro		
	3.6	Supplying and making indoor end termination with Brass compression gland and Aluminium lugs for following size of PVC insulated and PVC sheathed/ XLPE aluminium conductor cable of 1.1 KV grade as required.	700			
termination with Brass compression gland and Aluminium lugs for following size of PVC insulated and PVC sheathed/ XLPE aluminium conductor cable of 1.1 KV grade as required.			12	Each		
termination with Brass compression gland and Aluminium lugs for following size of PVC insulated and PVC sheathed/ XLPE aluminium conductor cable of 1.1 KV grade as required.  a) 3 x 2.5 Sq.mm (copper)  12 Each		b) 2 x 16 sqmm (22mm) c) 3 1/2 x 25 sqmm (32 mm)	4	Each		
termination with Brass compression gland and Aluminium lugs for following size of PVC insulated and PVC sheathed/ XLPE aluminium conductor cable of 1.1 KV grade as required.  a) 3 x 2.5 Sq.mm (copper)  b) 2 x 16 sqmm (22mm)  12 Each Each			6	Each	i	

	d) 3 1/2 x 50 sqmm	2	Each	
3.7	Supply of heavy duty 1100 V Grade, X LPE insulated, PVC sheathed armounred cable with aluminium/copper conductor for the following sizes with ISI mark confirming to relevant IS code mended up to date as required.			
	a) 31/2 x 50 sqmm Alumminium armoured cable.	50	Metre	
	b) 31/2 x 25 sqmm Aluminium armoured cable.	100	Metre	
	c) 2 x 16 sq.mm Aluminium armoured cable	50	Metre	
	d) 3 x 2.5 sqmm copper conductor armoured cable.  (Telephone Cabeling)	50	Metre	
3.8				
3.8	Supply of following 0.5 mm size conductor jelly filled PVC insulated and PVC sheathed telecommunication cable with G.I.Wire/strip armouring generally confirming to ITD specifications/WS-113 C & S/WS-114 armouring and outer sheath confirming to IS: 1554 (Part –I) as required.			
	(a) 10 pair armoured	60	Metre	
3.9	Supplying and fixing of following sizes of Krone telephone tag block including termination of paired wires in 2 mm thick MS box of suitable size designed to include the tag blocks with sufficient space and with hinged locable metal cover duly painted as required.	1	Each	
3.10	Supply and fixing of 50 mm dia. Gl pipe Light	·	240.1	
	duty on surface/recess with all accessories including making good the damages same as			
	required.	30	Metre	

EE/UWD

